

ZP\_COSYGP\_3h DMSO {C:\Bruker\TopSpin3.6.0} AMP 7




Current Data Parameters  
NAME CCY\_89\_01-W-DMSO  
EXPNO 11  
PROCNO 1

F2 - Acquisition Parameters  
Date\_ 20220428  
Time 1.43 h  
INSTRUM spect  
PROBHD Z108618\_1022 (  
PULPROG cosydfph  
TD 2048  
SOLVENT DMSO  
NS 22  
DS 16  
SWH 4098.361 Hz  
FIDRES 4.002306 Hz  
AQ 0.2498560 sec  
RG 198.49  
DW 122.000 usec  
DE 6.50 usec  
TE 298.1 K  
D0 0.00010386 sec  
D1 1.67969298 sec  
D13 0.00000400 sec  
IN0 0.00024400 sec  
TDav 1  
SFO1 400.1315486 MHz  
NUC1 1H  
P1 14.25 usec  
PLW1 13.53400040 W

F1 - Acquisition parameters  
TD 256  
SFO1 400.1315 MHz  
FIDRES 32.018444 Hz  
SW 10.243 ppm  
FnMODE States-TPPI

F2 - Processing parameters  
SI 1024  
SF 400.1300026 MHz  
WDW QSINE  
SSB 2  
LB 0 Hz  
GB 0  
PC 1.40

F1 - Processing parameters  
SI 1024  
MC2 States-TPPI  
SF 400.1300026 MHz  
WDW QSINE  
SSB 2  
LB 0 Hz  
GB 0

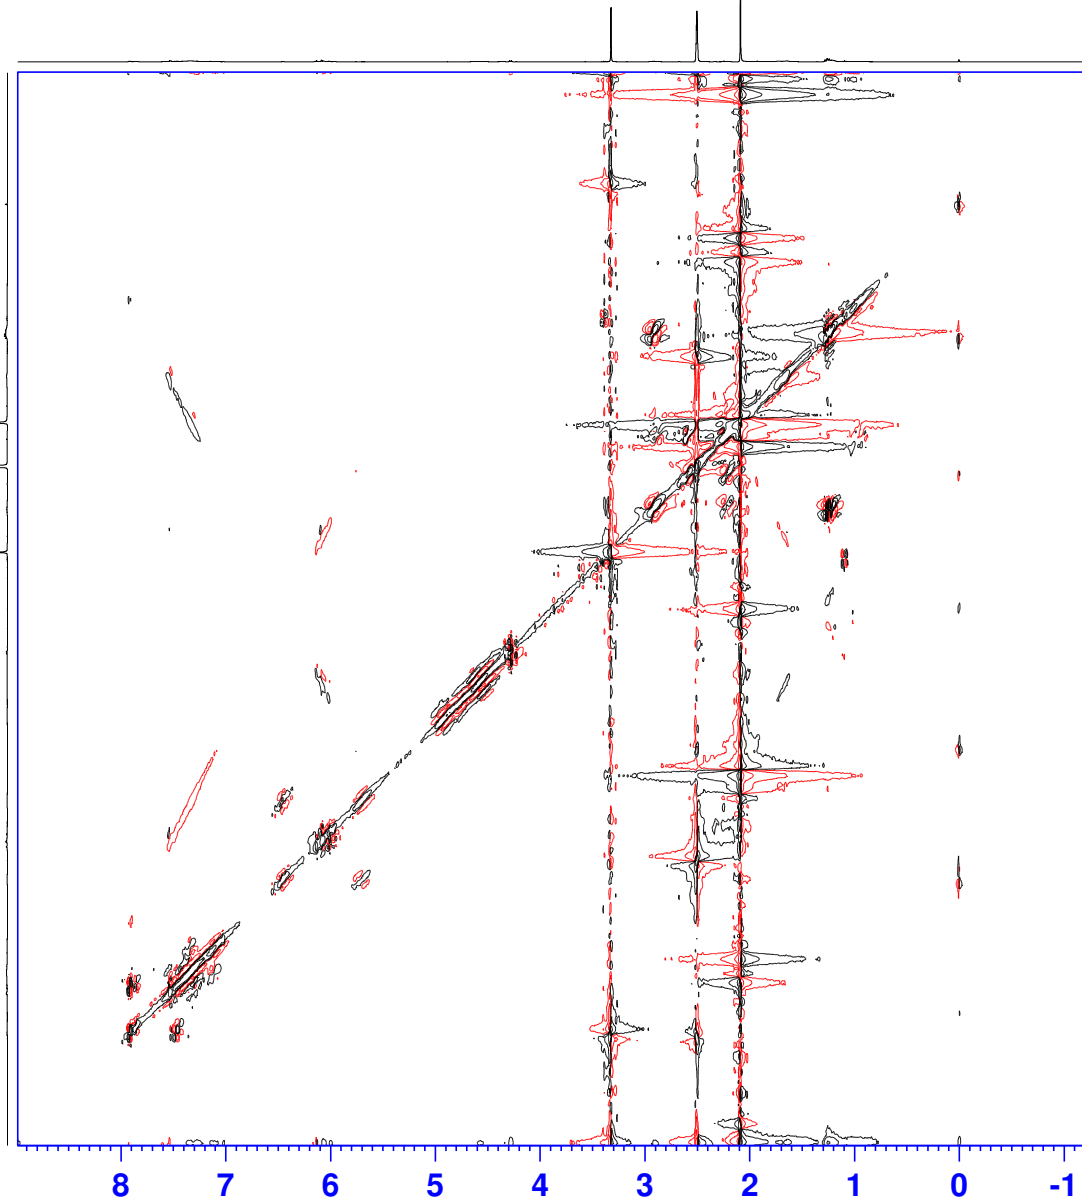

ppm

-1

0

1

2

3

4

5

6

7

8

ppm